



TUDOR GOLD

GOLDSTORM ZONE


Section 115+50 NE

View 030

GS-20-64

NW

SE

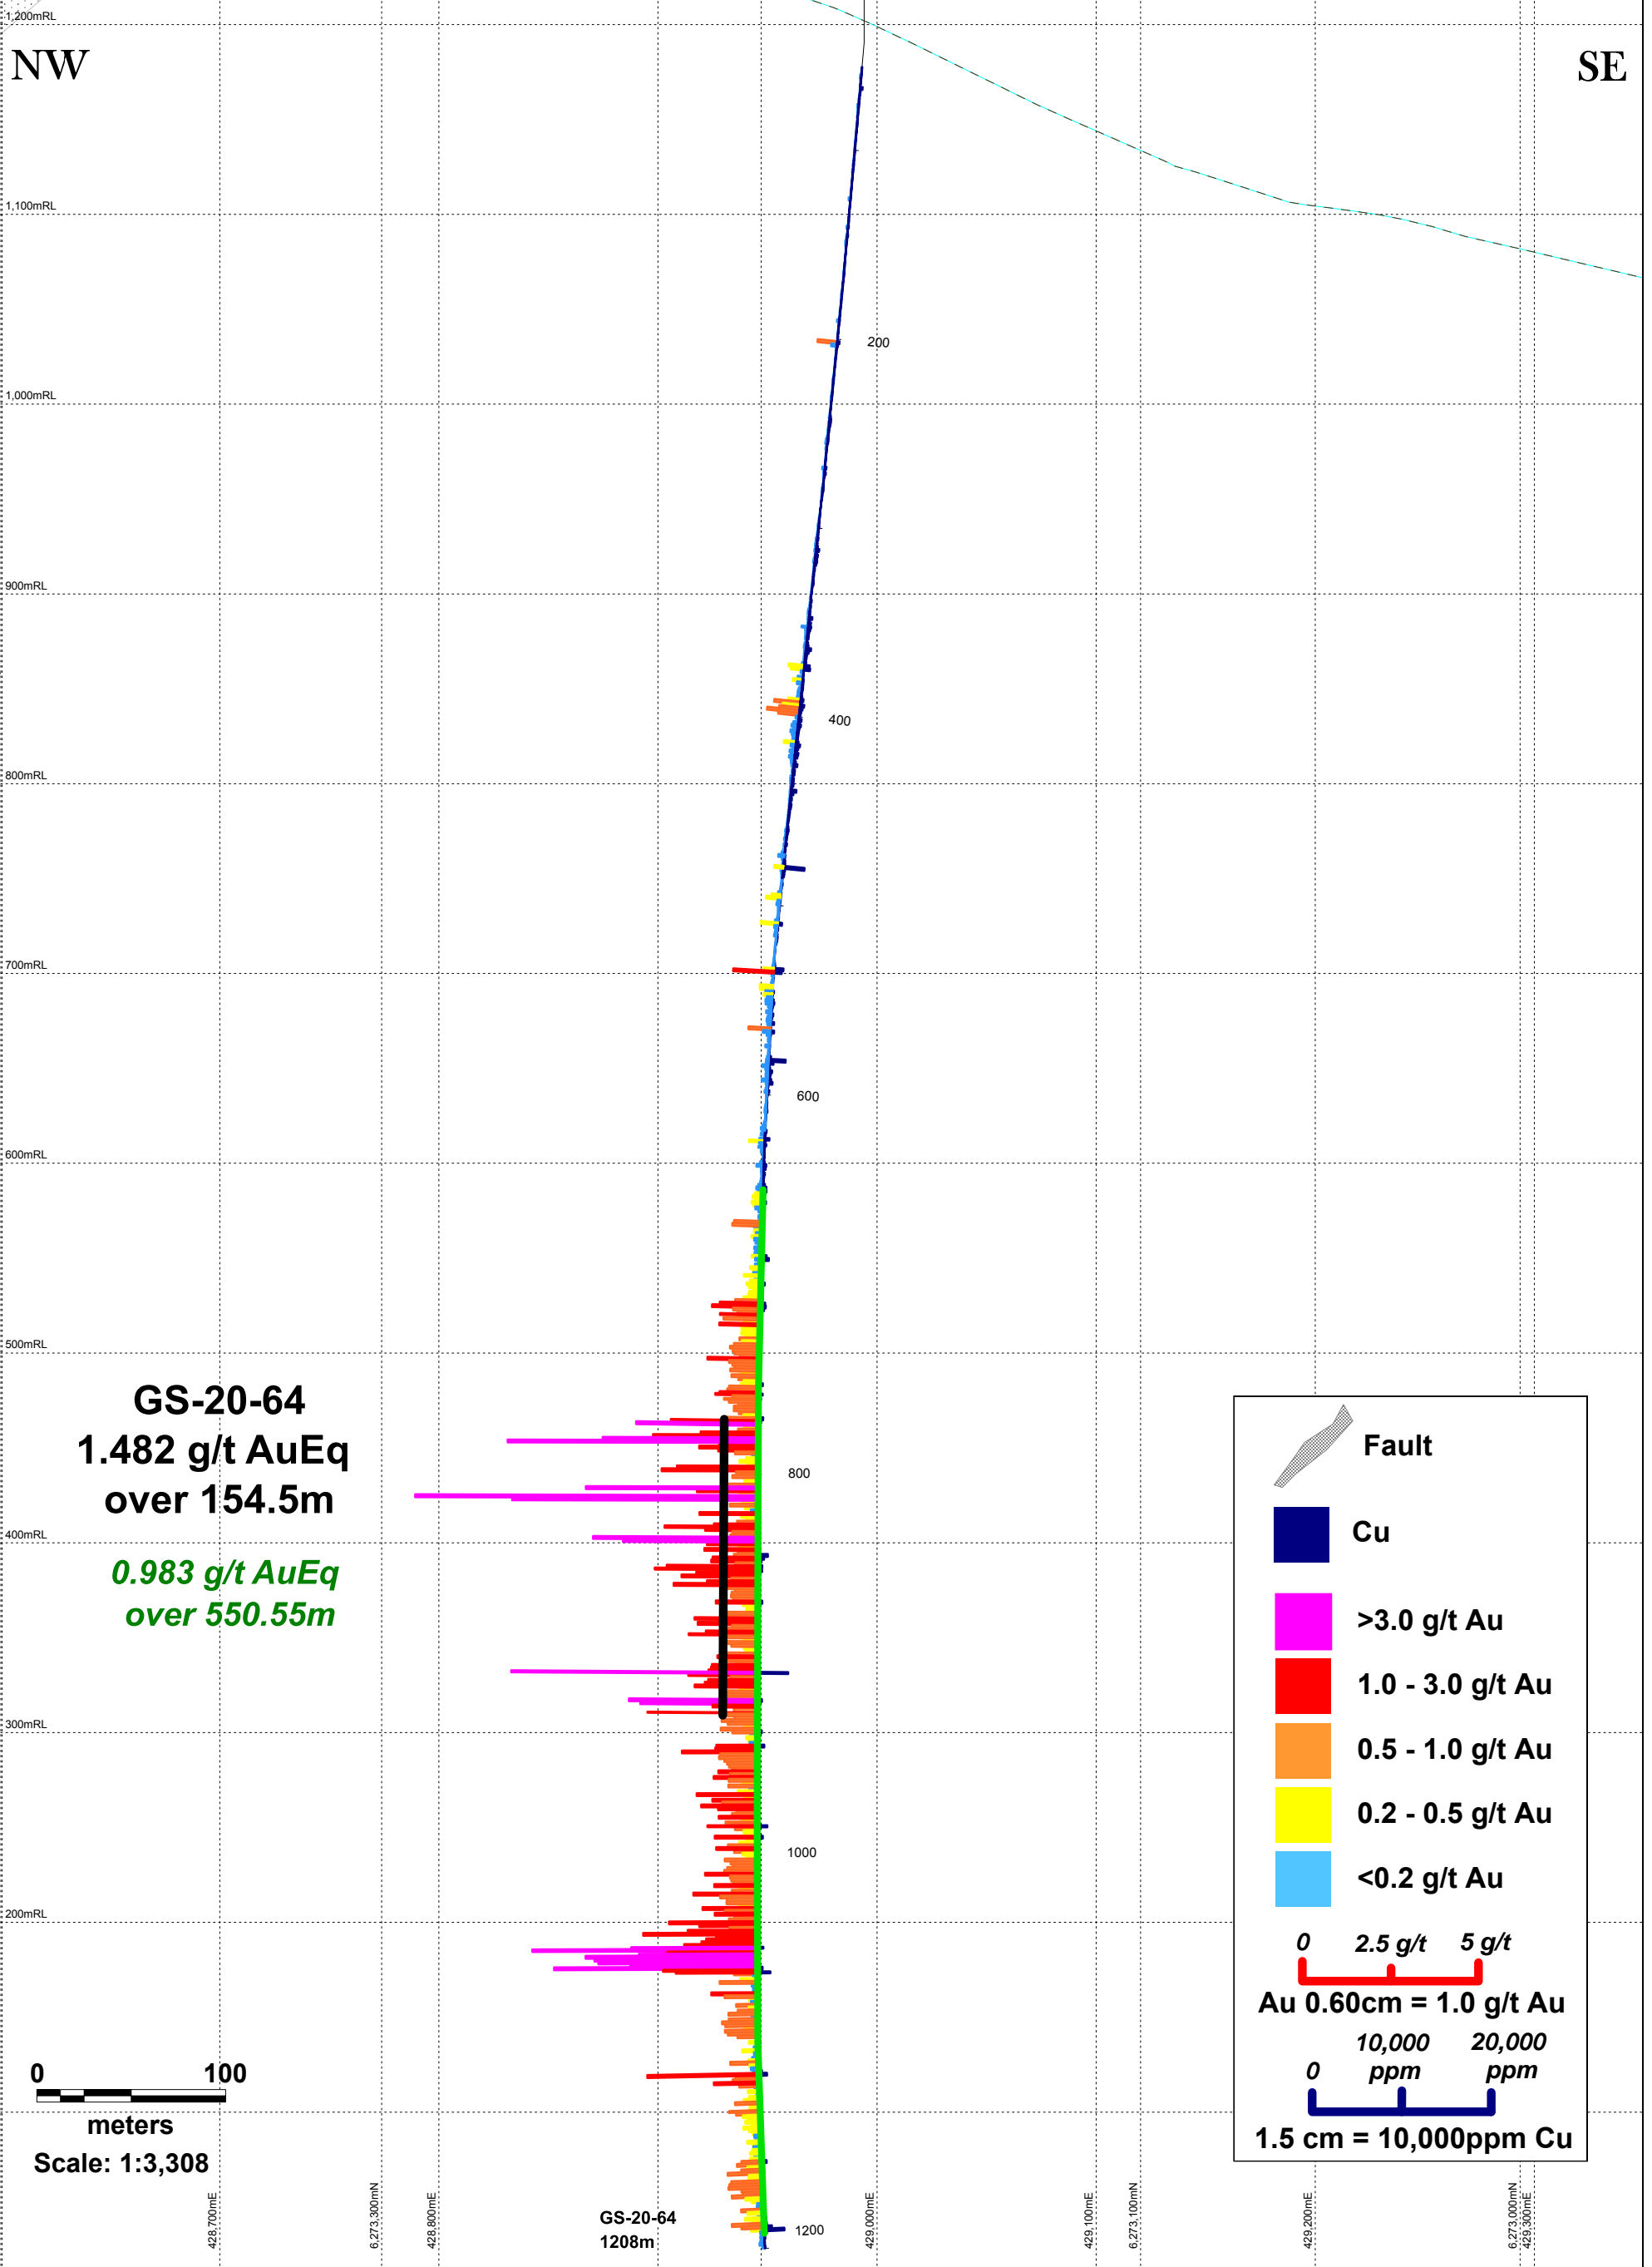

GS-20-64
1.482 g/t AuEq
over 154.5m

0.983 g/t AuEq
over 550.55m

Fault

Cu

>3.0 g/t Au

1.0 - 3.0 g/t Au

0.5 - 1.0 g/t Au

0.2 - 0.5 g/t Au

<0.2 g/t Au

0 2.5 g/t 5 g/t

Au 0.60cm = 1.0 g/t Au

0 10,000 20,000 ppm

1.5 cm = 10,000ppm Cu

0 100
 meters
 Scale: 1:3,308

6,273,400mN 428,700mE 6,273,300mN 428,800mE GS-20-64 1208m 429,000mE 429,100mE 6,273,100mN 429,200mE 6,273,000mN 429,300mE